

BWR Vessel and Internals Project Internal Core Spray Piping and Sparger Repair Design Criteria (BWRVIP-19NP)

NON-PROPRIETARY INFORMATION

NOTICE: This report contains the non-proprietary information that is included in the proprietary version of this report. The proprietary version of this report contains proprietary information that is the intellectual property of BWRVIP utility members and EPRI. Accordingly, the proprietary report is available only under license from EPRI and may not be reproduced or disclosed, wholly or in part, by any Licensee to any other person or organization.

REPORT SUMMARY

The Boiling Water Reactor Vessel and Internals Project (BWRVIP), formed in June, 1994, is an association of utilities focused exclusively on BWR vessel and internals issues. This BWRVIP report documents criteria which can be used to design a repair for cracks which have been known to occur in BWR core spray piping.

Background

A number of BWR plants have experienced stress corrosion cracking in the core spray piping which is located internal to the reactor pressure vessel. A variety of mechanical and welded techniques have been proposed to repair the cracks. Since a large number of concerns need to be addressed in designing such a repair, it is useful to have these criteria set down in a comprehensive document.

Objective

To compile a core spray piping and sparger repair design criteria that can be used to perform repair design and that can be submitted to the appropriate regulatory agencies for approval of a generic design process.

Approach

The project team assembled a draft document that discussed all elements which need to be considered in designing a repair to the core spray piping or spargers. These items include: design objectives; structural evaluation; system evaluation, materials, fabrication and installation considerations; and, required inspection and testing. The draft was then reviewed in depth by BWRVIP utility representatives as well as third party contractors. The final report incorporates comments received during that review.

Results

The document provides general design acceptance criteria for the temporary or permanent repair of core spray piping and spargers. Repairs designed to meet these criteria will maintain the structural integrity of the core spray system under normal operation as well as under postulated transient and design basis accident conditions.

EPRI Perspective

The criteria listed in the report define a standard set of considerations which are important in designing a core spray piping repair. It is intended that these criteria will be submitted to the USNRC and, possibly, non-US regulators, for their approval. Regulatory acceptance of these generic criteria will significantly reduce the utility effort required to obtain approval for plant-specific repairs.

TR-106893NP

Keywords

Boiling water reactor

Core spray

Repair

Boiling water reactor

Stress corrosion cracking

Vessel and Internals

BWR Vessel and Internals Project

Internal Core Spray Piping and Sparger Repair Design Criteria (BWRVIP-19NP)

TR-106893NP

Research Project B501

Final Report, February 2000

Prepared by:

**BOILING WATER REACTOR VESSEL AND INTERNALS PROJECT
REPAIR COMMITTEE**

GE NUCLEAR ENERGY

Prepared for

**BOILING WATER REACTOR VESSEL & INTERNALS PROJECT and
ELECTRIC POWER RESEARCH INSTITUTE**

3412 Hillview Ave.

Palo Alto, California 943040

DISCLAIMER OF WARRANTIES AND LIMITATION OF LIABILITIES

This report was prepared by the organization(s) named below as an account of work sponsored or cosponsored by the BWR Vessel and Internals Project (BWRVIP) and the Electric Power Research Institute, Inc. (EPRI). Neither BWRVIP, EPRI, any member of EPRI, any cosponsor, the organization(s) named below, nor any person acting on behalf of any of them:

(a) makes any warranty or representation whatsoever, express or implied, (i) with respect to the use of any information, apparatus, method, process or similar item disclosed in this report, including merchantability and fitness for a particular purpose, or (ii) that such use does not infringe on or interfere with privately owned rights, including any party's intellectual property, or (iii) that this report is suitable to any particular user's circumstance, or

(b) assumes any responsibility for any damages or other liability whatsoever (including any consequential damages, even if BWRVIP, EPRI or any EPRI representative has been advised of the possibility of such damages) resulting from your selection or use of this report or any information, apparatus, method, process or similar item disclosed in this report.

Organization(s) that prepared this report:

**BOILING WATER REACTOR VESSEL AND INTERNALS PROJECT REPAIR COMMITTEE
GE NUCLEAR ENERGY**

ORDERING INFORMATION

Requests for copies of this report should be directed to the BWRVIP Program Manager, 3412 Hillview Ave., Palo Alto, Ca. 94304, (415) 855-2340.

ABSTRACT

The Boiling Water Reactor Vessel and Internals Project (BWRVIP) was formed in June 1994 as a utility-directed initiative to address BWR vessel and internals issues. This criteria document was developed by the Repair Technical Subcommittee of the BWRVIP.

This document provides the general design acceptance criteria for temporary and permanent repair of internal core spray piping and spargers. It is provided to assist BWR owners in designing repairs which maintain the structural integrity of the internal core spray piping and spargers during normal operation and under postulated transient and design basis accident conditions for the remaining plant life or other service life as specified by the plant owner.

Issuance of this document is not intended to imply that repair of internal core spray piping and spargers is the only viable method for resolving cracking in internal core spray piping and spargers. Due to variation in the material, fabrication, environment and as-found condition of individual internal core spray piping and spargers, repair is only one of several options that are available. The action to be taken for individual plants will be determined by the plant licensee.

TABLE OF CONTENTS

1.	INTRODUCTION	1-1
	1.1 Background	1-1
	1.2 Purpose	1-1
	1.3 Scope	1-1
2.	DEFINITIONS	2-1
3.	INTERNAL CORE SPRAY PIPING AND SPARGER CHARACTERISTICS AND SAFETY FUNCTION	3-1
	3.1 Generic Physical Description	3-1
	3.2 Safety Design Bases	3-1
	3.3 Event Analyses	3-1
	3.3.1 Normal Operation	3-1
	3.3.2 Anticipated Operational Occurrences (Upset Conditions)	3-2
	3.3.3 Design Basis Accidents (Emergency/Faulted Conditions)	3-2
	3.3.4 Loading Combinations	3-2
4.	SCOPE OF REPAIR	4-1
5.	DESIGN OBJECTIVES	5-1
	5.1 Repair Design Life	5-1
	5.2 Safety Design Bases	5-1
	5.3 Safety Analysis Events	5-1
	5.4 Structural Integrity	5-1
	5.5 Retained Flaw(s)	5-1
	5.6 Loose Parts Considerations	5-1
	5.7 Physical Interfaces with Other Reactor Internals	5-2
	5.8 Installation	5-2

TABLE OF CONTENTS (continued)

6.	DESIGN CRITERIA	6-1
7.	STRUCTURAL AND DESIGN EVALUATION	7-1
7.1	Significant Loads	7-1
7.1.1	Significant Loads - Internal Core Spray Piping and Supports.....	7-1
7.1.2	Significant Loads - Core Spray Spargers and Supports.....	7-4
7.2	Load Combinations	7-4
7.2.1	Load Combinations - Internal Core Spray Piping and Supports	7-4
7.2.2	Load Combinations - Core Spray Spargers and Supports	7-6
7.3	Allowable Stresses	7-6
7.4	Consideration of Shroud Repair or Cracking	7-7
7.5	Flow Induced Vibration	7-7
7.6	Repair Impact on Existing Internal Components	7-7
7.7	Radiation Effects on Repair Design.....	7-7
7.8	Analysis Codes	7-8
7.9	Thermal Cycles	7-8
7.10	Corrosion Allowance.....	7-8
8.	SYSTEM EVALUATION	8-1
8.1	Leakage.....	8-1
8.1.1	Leakage Impact - Normal Operation	8-1
8.1.2	Leakage Impact - Accident Conditions	8-1
8.1.3	Leakage Acceptance Criteria - Internal Core Spray Piping.....	8-2
8.1.4	Leakage Acceptance Criteria - Core Spray Spargers	8-2
8.2	Internal Core Spray Piping Pressure Drop	8-3
8.3	Impact to Flow Distribution	8-3
8.4	Emergency Operating Procedure (EOP) Calculations	8-3
8.5	Power Uprate	8-3

TABLE OF CONTENTS (continued)

8.6 Internal Core Spray Piping High Point Vent	8-3
8.7 Sparger Spray Distribution	8-3
9. MATERIALS, FABRICATION AND INSTALLATION	9-1
9.1 Materials.....	9-1
9.2 Crevices	9-2
9.3 Welding and Fabrication	9-2
9.4 Pre-Installation As-Built Inspection	9-3
9.5 Installation Cleanliness	9-3
9.6 ALARA	9-4
9.7 Qualification of Critical Design Parameters.....	9-4
10. INSPECTION AND TESTING	10-1
10.1 Inspection Access	10-1
10.2 Pre and Post Installation Inspection.....	10-1
11. QUALITY ASSURANCE PROGRAM	11-1
12. DOCUMENTATION	12-1
13. REFERENCES	13-1

LIST OF FIGURES

Figure 3-1	BWR2 Core Spray Piping Configuration	3-3
Figure 3-2	BWR3-5 Core Spray Piping Configuration	3-4
Figure 3-3	BWR6 Typical BWR6 Core Spray Piping Configuration	3-5
Figure 3-4	Elevation View of Typical BWR Showing Core Spray Spargers and Bwr3/4/5 Coupling.....	3-6
Figure 3-5	Plan View of Typical Core Spray Spargers	3-7

1. INTRODUCTION

1.1 Background

Core spray line/sparger cracking was first detected in 1978 during routine in-vessel visual inspections. As the cracking was found to be more widespread in subsequent years, and recognizing the nature of stress corrosion cracking, the NRC issued IE Bulletin 80-13, requiring that visual inspections be done of a better quality than those required by the ASME Code. Plants have been performing inspections to the IE Bulletin 80-13 requirements for many years, and have continued to find and address core spray line/sparger cracking.

Recently, the BWRVIP prepared a safety assessment of BWR internals as a follow-on to the activities completed on shroud cracking. In the evaluation of internal core spray piping and spargers and the consequences of internal core spray pipe cracking, it was clear that inspection is an important part of assessing internal core spray piping integrity, and thus the ability to achieve safe shutdown for worst case scenarios. As a result, the BWRVIP made development of the core spray inspection and evaluation guidelines a high priority for 1996.

In parallel, field cracking at creviced locations was found by visual inspection of the outside surfaces of internal core spray piping in the shroud annulus. Supplemental ultrasonic inspection showed that actual cracking could be considerably more severe than was shown by the outside visual indications. This field experience raised the priority of BWRVIP internal core spray piping and spargers assessment and repair activities culminating in the requirements set forth in this document.

1.2 Purpose

The purpose of this document is to provide general design acceptance criteria for permanent and temporary repair of 300 series stainless steel (SS) internal core spray piping and spargers.

The issuance of this document is not intended to imply that a repair of 300 series SS internal core spray piping and spargers is the only viable approach to resolution of the cracking issue for BWR internal core spray piping.

1.3 Scope

This document is applicable to General Electric BWR/2, BWR3-5, and BWR/6 plants which plan to implement repairs of the 300 series SS internal core spray

pipng and spargers (including their supports) that are subject to cracking. Other RPV internals repairs are not within the scope of this document.

2. DEFINITIONS

Repair	Repair as used in the context of this document is a broad term that applies to actions taken to design, analyze, fabricate and install hardware that restores the structural and functional integrity of all or a portion of the internal core spray piping and spargers. Weld overlay, without removal of the defect, is also considered a repair in the context of this criteria.
Internal Core Spray Piping	Internal Core Spray Piping is defined to include all of the core spray piping internal to the reactor vessel including: the core spray nozzle thermal sleeve (but not including the nozzle safe end), the piping which runs from the thermal sleeve to the shroud (including the connection to the core shroud) sometimes referred to as the core spray line (CSL).
Core Spray Sparger	For the purpose of this criteria, the core spray spargers are taken to be either the upper or lower core spray spargers which are entirely within the core shroud. The upper and lower sparger consists of two sparger halves which extend approximately 180 degrees around the inside of the shroud.

The original manufacturing drawing nomenclature (titles) differs from the above definitions in that the Sparger, as shown on the sparger or shroud drawing, extends through the shroud, includes an upward directed elbow, a short vertical spool section and female coupling which are located in the annulus. The decision to use the shroud wall as the dividing line between Internal Core Spray Piping and Core Spray Sparger was made to simplify the definition of repair criteria.

3. INTERNAL CORE SPRAY PIPING AND SPARGER CHARACTERISTICS AND SAFETY FUNCTION

3.1 Generic Physical Description

The internal core spray piping and sparger assemblies are constructed of austenitic stainless steel. The internal core spray piping provides the flow path for core cooling water from the vessel nozzle, through the shroud (BWR 2-5) or top guide (BWR 6) to the core spray spargers that provide distribution of core spray flow over the core to assure long-term cooling when the core cannot be reflooded. The assembly consists of junction or T-box connections that route flow to different piping runs, welded joints needed to construct the individual piping segments in the assembly and spray nozzles in the spargers that provide the spray distribution over the core. Internal brackets are used to support internal core spray piping and spargers at different locations along the piping runs. Figures 3-1 through 3-3 show the overall configuration of the internal core spray piping assembly for each of the main categories of plants: BWR 2, BWR 3-5 and BWR 6. Figures 3-4 and 3-5 show a typical core spray sparger configuration.

3.2 Safety Design Bases

**Content Deleted -
EPRI Proprietary Information**

3.3 Event Analyses

As previously stated, the purpose of this document is to provide general design criteria for repairs for 300 series SS internal core spray piping and spargers susceptible to cracking. Accordingly, various events and operational conditions must be considered to ensure that the repair does not inhibit the ability of the internal core spray piping and core spray spargers to perform their basic safety functions. The following general load cases shall be considered in design of the proposed repair.

3.3.1 Normal Operation

**Content Deleted -
EPRI Proprietary Information**

3.3.2 Anticipated Operational Occurrences (Upset Conditions)

**Content Deleted -
EPRI Proprietary Information**

3.3.3 Design Basis Accidents (Emergency/Faulted Conditions)

**Content Deleted -
EPRI Proprietary Information**

3.3.4 Loading Combinations

**Content Deleted -
EPRI Proprietary Information**

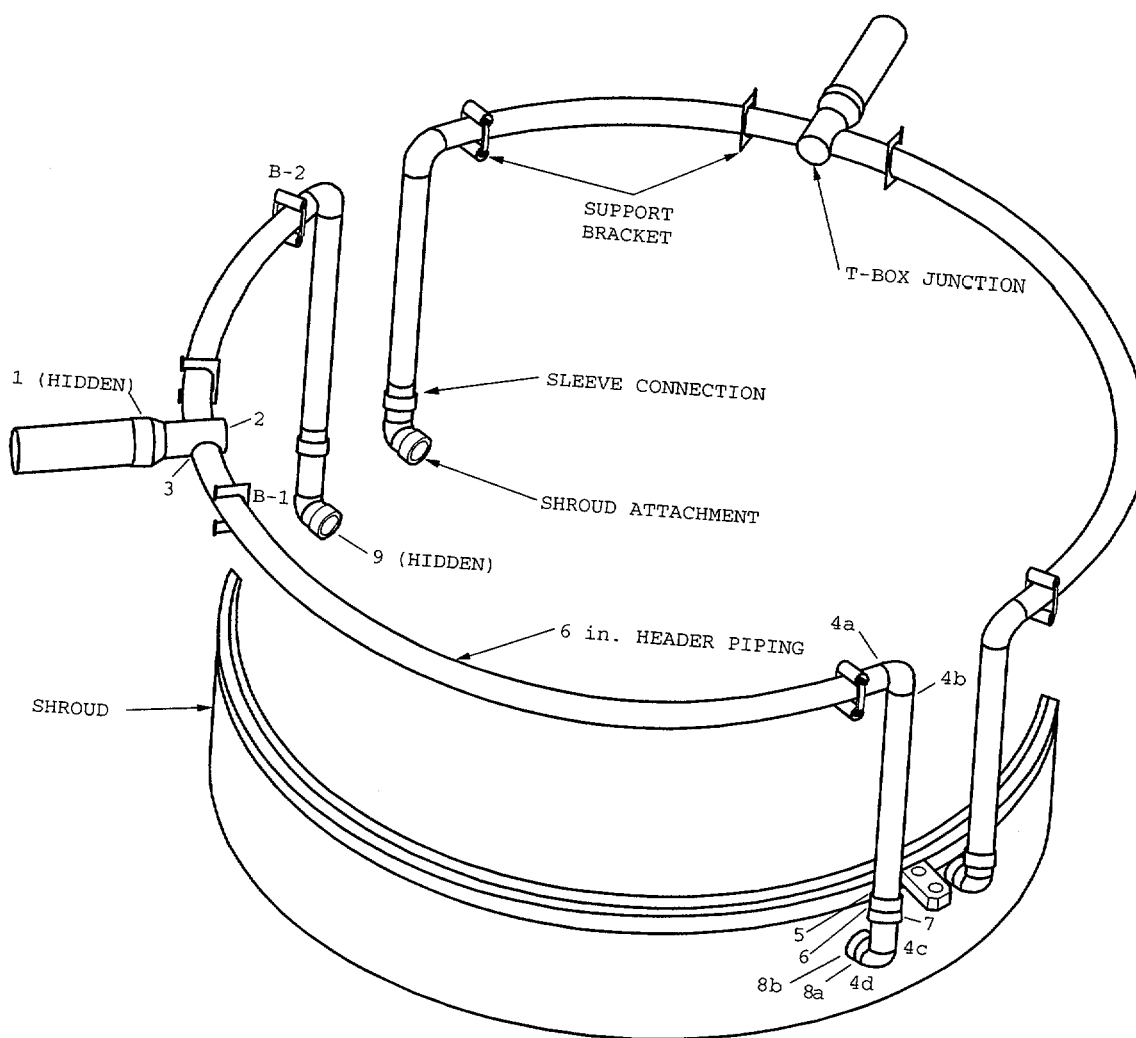


Figure 3-2 Typical BWR 3 - 5 Core Spray Piping Configuration

(304S.SMATLS)

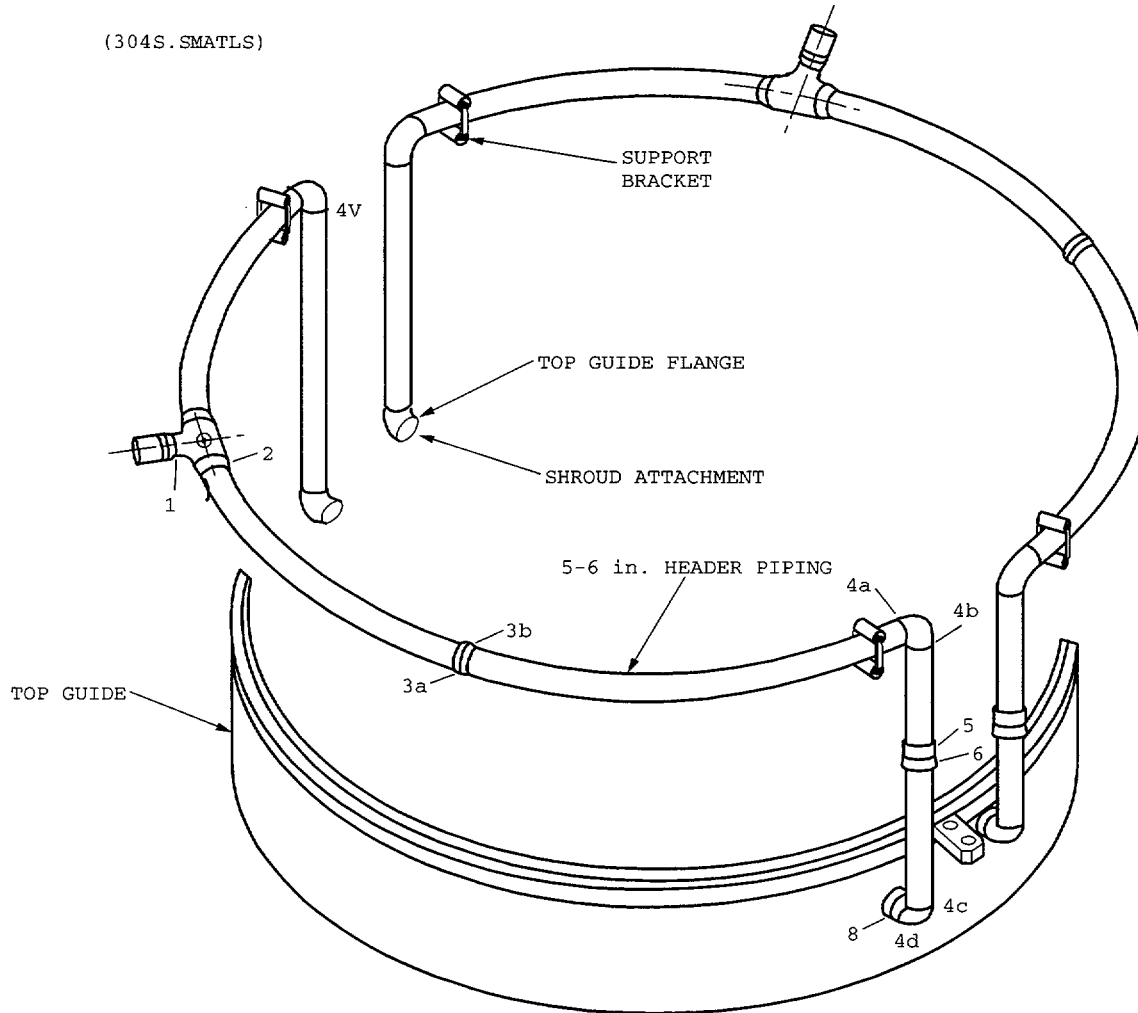


Figure 3-3 Typical BWR 6 Core Spray Piping Configuration

**Content Deleted -
EPRI Proprietary Information**

Figure 3-4 Elevation View of Typical BWR Showing Core Spray Spargers
and BWR3/4/5 Coupling

**Content Deleted -
EPRI Proprietary Information**

Figure 3-5 Plan View of Typical Core Spray Spargers

4. SCOPE OF REPAIR

The internal core spray piping and sparger repair will address cracking in IGSCC susceptible stainless steel internal core spray piping and spargers by local repair(s) which leave the flaw(s) in place. Repair of internal piping supports (on the vessel wall or the shroud) is also included with the repair of internal core spray piping and spargers.

When the vessel nozzle safe end, a weld attaching the nozzle thermal sleeve to the nozzle safe end or a support attachment weld to the reactor pressure vessel is involved in the repair of internal core spray piping, ASME Class 1 Vessel requirements must be invoked for the portion within the ASME Section III vessel jurisdiction.

5. DESIGN OBJECTIVES

5.1 Repair Design Life

**Content Deleted -
EPRI Proprietary Information**

5.2 Safety Design Bases

**Content Deleted -
EPRI Proprietary Information**

5.3 Safety Analysis Events

**Content Deleted -
EPRI Proprietary Information**

5.4 Structural Integrity

**Content Deleted -
EPRI Proprietary Information**

5.5 Retained Flaw(s)

**Content Deleted -
EPRI Proprietary Information**

5.6 Loose Parts Considerations

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

5.7 Physical Interfaces with Other Reactor Internals

**Content Deleted -
EPRI Proprietary Information**

5.8 Installation

**Content Deleted -
EPRI Proprietary Information**

6. DESIGN CRITERIA

**Content Deleted -
EPRI Proprietary Information**

7. STRUCTURAL AND DESIGN EVALUATION

7.1 Significant Loads

7.1.1 Significant Loads - Internal Core Spray Piping and Supports

**Content Deleted -
EPRI Proprietary Information**

**Dead Weight (DW) Content Deleted -
EPRI Proprietary Information**
Seismic Inertia

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

Seismic Anchor Displacement

**Content Deleted -
EPRI Proprietary Information**

Fluid Drag

**Content Deleted -
EPRI Proprietary Information**

Core Spray Injection Loading (CSIN)

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

Pressure/Thermal Loads and Anchor Displacements:

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

7.1.2 Significant Loads - Core Spray Spargers and Supports

**Content Deleted -
EPRI Proprietary Information**

7.2 Load Combinations

**Content Deleted -
EPRI Proprietary Information**

7.2.1 Load Combinations - Internal Core Spray Piping and Supports

The following are a suggested set of load combinations that may be used for the Normal/Upset conditions:

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

7.2.2 Load Combinations - Core Spray Spargers and Supports

The following are a suggested set of load combinations that may be used for the Normal/Upset condition:

**Content Deleted -
EPRI Proprietary Information**

7.3 Allowable Stresses

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

7.4 Consideration of Shroud Repair or Cracking

**Content Deleted -
EPRI Proprietary Information**

7.5 Flow Induced Vibration

**Content Deleted -
EPRI Proprietary Information**

7.6 Repair Impact on Existing Internal Components

**Content Deleted -
EPRI Proprietary Information**

7.7 Radiation Effects on Repair Design

**Content Deleted -
EPRI Proprietary Information**

7.8 Analysis Codes

**Content Deleted -
EPRI Proprietary Information**

7.9 Thermal Cycles

**Content Deleted -
EPRI Proprietary Information**

7.10 Corrosion Allowance

**Content Deleted -
EPRI Proprietary Information**

8. SYSTEM EVALUATION

8.1 Leakage

**Content Deleted -
EPRI Proprietary Information**

8.1.1 Leakage Impact - Normal Operation

**Content Deleted -
EPRI Proprietary Information**

8.1.2 Leakage Impact - Accident Conditions

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

8.1.3 Leakage Acceptance Criteria - Internal Core Spray Piping

**Content Deleted -
EPRI Proprietary Information**

8.1.4 Leakage Acceptance Criteria - Core Spray Spargers

**Content Deleted -
EPRI Proprietary Information**

8.2 Internal Core Spray Piping Pressure Drop

**Content Deleted -
EPRI Proprietary Information**

8.3 Impact to Flow Distribution

**Content Deleted -
EPRI Proprietary Information**

8.4 Emergency Operating Procedure (EOP) Calculations

**Content Deleted -
EPRI Proprietary Information**

8.5 Power Uprate

**Content Deleted -
EPRI Proprietary Information**

8.6 Internal Core Spray Piping High Point Vent

**Content Deleted -
EPRI Proprietary Information**

8.7 Sparger Spray Distribution

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

9. MATERIALS, FABRICATION AND INSTALLATION

9.1 Materials

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

9.2 Crevices

**Content Deleted -
EPRI Proprietary Information**

9.3 Welding and Fabrication

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

9.4 Pre-Installation As-Built Inspection

**Content Deleted -
EPRI Proprietary Information**

9.5 Installation Cleanliness

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

9.6 ALARA

**Content Deleted -
EPRI Proprietary Information**

9.7 Qualification of Critical Design Parameters

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

10. INSPECTION AND TESTING

10.1 Inspection Access

**Content Deleted -
EPRI Proprietary Information**

10.2 Pre and Post Installation Inspection

**Content Deleted -
EPRI Proprietary Information**

11. QUALITY ASSURANCE PROGRAM

**Content Deleted -
EPRI Proprietary Information**

12. DOCUMENTATION

The following documentation shall be prepared and maintained as permanent records:

**Content Deleted -
EPRI Proprietary Information**

13. REFERENCES

1. NRC I&E Bulletin 80-13
2. ASME Boiler and Pressure Vessel Code Section III, 1989 Edition
3. ASME Boiler and Pressure Vessel Code Section V, 1989 Edition
4. ASME Boiler and Pressure Vessel Code Section XI, 1989 Edition
5. USAS B31.1.0, Power Piping
6. Regulatory Guide 1.85, Materials Code Case Acceptability - ASME Section III, Division I
7. 10CFR50.55a, Codes and Standards
8. Regulatory Guide 1.44, Control of the Use of Sensitized Stainless Steel
9. EPRI Document NP-7032, Material Specification for Alloy X-750 for Use in LWR Internal Components, Revision 1
10. ASTM A-262, Detecting Susceptibility to Intergranular Attack in Stainless Steel
11. Regulatory Guide 1.31, Control of Ferrite Content in Stainless Steel Weld Metal
12. EPRI Document 84-MG-18, Nuclear Grade Stainless Steel Procurement, Manufacturing and Fabrication Guidelines
13. Code Case N-516, Underwater Welding Section XI, Division, Approved August 9, 1993
14. AWS Standard D3.6-89, Specification for Underwater Welding
15. 10CFR50.59
16. GENE Document NEDO-24547, Technical Description and Work Scope NSSS Design Adequacy Evaluations - New Loads, Dec. 1978
17. Regulatory Guide 1.71 Welder Qualification for Areas of Limited Accessibility

Target:


Nuclear Power

About EPRI

EPRI creates science and technology solutions for the global energy and energy services industry. U.S. electric utilities established the Electric Power Research Institute in 1973 as a nonprofit research consortium for the benefit of utility members, their customers, and society. Now known simply as EPRI, the company provides a wide range of innovative products and services to more than 1000 energy-related organizations in 40 countries. EPRI's multidisciplinary team of scientists and engineers draws on a worldwide network of technical and business expertise to help solve today's toughest energy and environmental problems.

EPRI. Powering Progress

© Electric Power Research Institute (EPRI), Inc. All rights reserved. Electric Power Research Institute and EPRI are registered service marks of the Electric Power Research Institute, Inc. EPRI. POWERING PROGRESS is a service mark of the Electric Power Research Institute, Inc.

 Printed on recycled paper in the United States of America

6893NP